

COUNTRY CHALET MOBILE HOME PARK (PWS 5070012) SOURCE WATER ASSESSMENT FINAL REPORT

September 13, 2000



State of Idaho Department of Environmental Quality

Disclaimer: This publication has been developed as part of an informational service for the source water assessments of public water systems in Idaho and is based on data available at the time and the professional judgement of the staff. Although reasonable efforts have been made to present accurate information, no guarantees, including expressed or implied warranties of any kind, are made with respect to this publication by the State of Idaho or any of its agencies, employees, or agents, who also assume no legal responsibility for the accuracy of presentations, comments, or other information in this publication. The assessment is subject to modification if new data is produced.

Executive Summary

Under the Safe Drinking Water Act Amendments of 1996, all states are required by the U.S. Environmental Protection Agency to assess every source of public drinking water for its relative sensitivity to contaminants regulated by the Act. This assessment is based on a land use inventory of the designated assessment area and sensitivity factors associated with the wells and aquifer characteristics.

This report, *Source Water Assessment for the Country Chalet Mobile Home Park, Idaho*, describes the public drinking water system, the boundaries of the zones of water contribution, and the associated potential contaminant sources located within these boundaries. This assessment should be used as a planning tool, taken into account with local knowledge and concerns, to develop and implement appropriate protection measures for this source. **The results should not be used as an absolute measure of risk and they should not be used to undermine public confidence in the water system.**

Country Chalet Mobile Home Park drinking water system consists of one well. Due to a high rating in hydrologic sensitivity and a high rating for system construction, the well has a high susceptibility to volatile organic contamination and synthetic organic contamination, inorganic contamination and microbial contamination. Though the delineation capture zone extends to the City of Ketchum and includes numerous potential contaminant sources, no categories of contamination have exceeded regulatory limits in the well water.

This assessment should be used as a basis for determining appropriate new protection measures or re-evaluating existing protection efforts. No matter what ranking a source receives, protection is always important. Whether the source is currently located in a “pristine” area or an area with numerous industrial and/or agricultural land uses that require education and surveillance, the way to ensure good water quality in the future is to act now to protect valuable water supply resources.

For Country Chalet Mobile Home Park, source water protection activities should focus on sustaining and implementing practices aimed at wellhead protection. Issues raised in the recent 1996 Drinking Water Supply Report should be addressed. Bringing the wellhead and surface seal up to standards will reduce the susceptibility ratings to moderate for inorganic and microbial contamination. Other practices aimed at reducing the movement of contaminants within the designated source water areas should be investigated. Disinfection practices could be implemented if microbial contamination ever became a concern. Most of the designated areas are outside the direct jurisdiction of Country Chalet Mobile Home Park. Partnerships with state and local agencies and industry groups should be established and are critical to success. Due to the time involved with the movement of groundwater, source water protection activities should be aimed at long-term management strategies even though these strategies may not yield results in the near term.

A community with a fully developed source water protection program will incorporate many strategies. For assistance in developing protection strategies please contact the Twin Falls Regional Office of the Idaho Department of Environmental Quality or the Idaho Rural Water Association.

SOURCE WATER ASSESSMENT FOR COUNTRY CHALET MOBILE HOME PARK, IDAHO

Section 1. Introduction - Basis for Assessment

The following sections contain information necessary to understand how and why this assessment was conducted. **It is important to review this information to understand what the ranking of this source means.** A map showing the delineated source water assessment area and the inventory of significant potential sources of contamination identified within that area are attached. The list of significant potential contaminant source categories and their rankings used to develop the assessment also is attached.

Background

Under the Safe Drinking Water Act Amendments of 1996, all states are required by the U.S. Environmental Protection Agency (EPA) to assess every source of public drinking water for its relative susceptibility to contaminants regulated by the Safe Drinking Water Act. This assessment is based on a land use inventory of the delineated assessment area and sensitivity factors associated with the wells and aquifer characteristics.

Level of Accuracy and Purpose of the Assessment

Since there are over 2,900 public water sources in Idaho, there is limited time and resources to accomplish the assessments. All assessments must be completed by May of 2003. An in-depth, site-specific investigation of each significant potential source of contamination is not possible. **Therefore, this assessment should be used as a planning tool, taken into account with local knowledge and concerns, to develop and implement appropriate protection measures for this source. The results should not be used as an absolute measure of risk and they should not be used to undermine public confidence in the water system.**

The ultimate goal of the assessment is to provide data to local communities to develop a protection strategy for their drinking water supply system. The Idaho Department of Environmental Quality (IDEQ) recognizes that pollution prevention activities generally require less time and money to implement than treatment of a public water supply system once it has been contaminated. IDEQ encourages communities to balance resource protection with economic growth and development. The decision as to the amount and types of information necessary to develop a source water protection program should be determined by the local community based on its own needs and limitations. Wellhead or source water protection is one facet of a comprehensive growth plan, and it can complement ongoing local planning efforts.

Section 2. Conducting the Assessment

General Description of the Source Water Quality

Country Chalet Mobile Home Park (MHP) is a community system serving approximately 55 people through 28 connections, located in Blaine County, two miles south of the City of Ketchum, in the Big Wood River valley (Figure 1). The public drinking water system for Country Chalet MHP is comprised of one well.

No significant water chemistry problems have been recorded in the well water. No inorganic contaminant (IOC) (i.e. nitrate) has been recorded above the Maximum Contaminant Level (MCL). Volatile organic contaminants (VOCs) and synthetic organic contaminants (SOCs) have never been detected in any of the drinking water. Total coliform bacteria are occasionally detected, but have never been detected on a repeat test. Though no significant water chemistry problems currently exist, the possibility of contamination from industrial and urban uses remains high.


Defining the Zones of Contribution--Delineation

The delineation process establishes the physical area around a well that will become the focal point of the assessment. The process includes mapping the boundaries of the zone of contribution into time of travel zones (zones indicating the number of years necessary for a particle of water to reach a well) for water in the aquifer. IDEQ used a refined computer model approved by the EPA in determining the 3-year (Zone 1B), 6-year (Zone 2), and 10-year (Zone 3) time of travel for water associated with the Big Wood River aquifer in the vicinity of Country Chalet MHP. The computer model used site specific data, assimilated by IDEQ from a variety of sources including local area well logs and various reports (Castelin and Winner, 1975; Frenzel, 1989). The delineation can best be described as bounding the valley floor north to and including the City of Ketchum (a total of more than 5 miles). The actual data used by IDEQ in determining the source water assessment delineation area is available upon request.

Identifying Potential Sources of Contamination

A potential source of contamination is defined as any facility or activity that stores, uses, or produces, as a product or by-product, the contaminants regulated under the Safe Drinking Water Act and has a sufficient likelihood of releasing such contaminants at levels that could pose a concern relative to drinking water sources. The goal of the inventory process is to locate and describe those facilities, land uses, and environmental conditions that are potential sources of groundwater contamination. The locations of potential sources of contamination within the delineation areas were obtained by field surveys conducted by IDEQ and from available databases.

FIGURE 1 - Geographic Location of Country Chalet Mobile Home Park

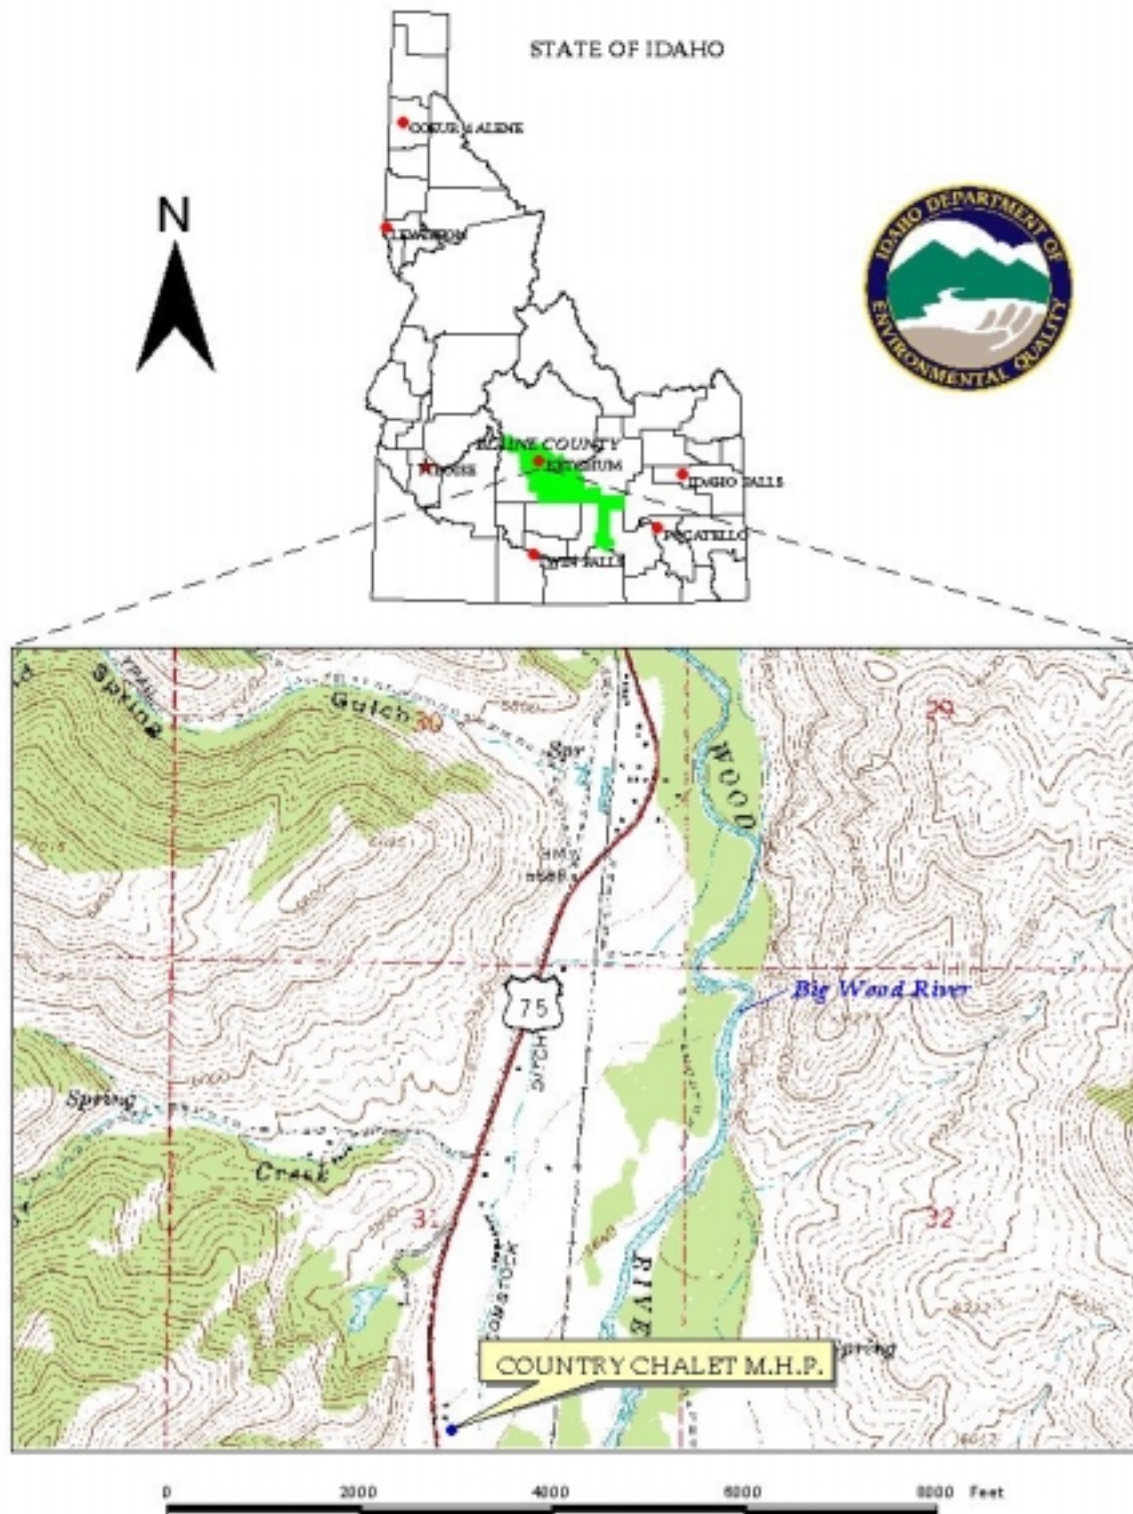

The dominant land use outside Country Chalet MHP area is undeveloped to urban uses. Land use within the immediate area of the wellhead consists of residential uses.

It is important to understand that a release may never occur from a potential source of contamination provided they are using best management practices. Many potential sources of contamination are regulated at the federal level, state level, or both to reduce the risk of release. Therefore, when a business, facility, or property is identified as a potential contaminant source, this should not be interpreted to mean that this business, facility, or property is in violation of any local, state, or federal environmental law or regulation. What it does mean is that the potential for contamination exists due to the nature of the business, industry, or operation. There are a number of methods that water systems can use to work cooperatively with potential sources of contamination. These involve educational visits and inspections of stored materials. Many owners of such facilities may not even be aware that they are located near a public water supply well.

Contaminant Source Inventory Process

A two-phased contaminant inventory of the study area was conducted during the spring and summer of 2000. The first phase involved identifying and documenting potential contaminant sources within Country Chalet MHP Source Water Assessment Area through the use of computer databases and Geographic Information System (GIS) maps developed by IDEQ. The second or enhanced phase of the contaminant inventory involved contacting the operator to validate the sources identified in phase one and to add any additional potential sources in the area. This task was undertaken with the assistance of Ted Miller of Country Chalet MHP.

Country Chalet MHP well has a total of 52 potential contaminant sites and two additional potential contaminant sources within the delineated source water areas (see Table 1, Figures 2 & 3). They consist of a number of general contractors, automotive services, furniture manufacturers, outdoor adventure businesses, commercial photographers, and various other businesses. There are businesses with underground storage tanks (USTs) and completed and uncompleted leaking underground storage tank (LUST) cleanups. Additionally there are National Pollutant Discharge Elimination System (NPDES) sites, Superfund Amendments and Reauthorization Act (SARA) sites, a Comprehensive Environmental Response Compensation and Liability Act (CERCLA) site, the Big Wood River, and Highway 75. Since the groundwater aquifer is hydraulically connected to the surface water system (Luttrell and Brockway, 1984), the Big Wood River will be considered a potential source of contamination. Highway 75 is also considered a potential contaminant source because of the possibility of spills and accidents.


Table 1. Country Chalet MHP, Potential Contaminant Inventory

| SITE # | Source Description | TOT Zone (years) | Source of Information | Potential Contaminants |
|--------|------------------------|------------------|-----------------------|------------------------|
| 1 | LUST-complete | 0-3 | Database Search | VOC, SOC |
| 2 | UST-open | 0-3 | Database Search | VOC, SOC |
| 3 | NPDES | 0-3 | Database Search | IOC |
| 4 | Fleet Terminal | 0-3 | Enhanced Inventory | VOC, SOC |
| 5 | Furniture Manufacturer | 0-3 | Enhanced Inventory | IOC, SOC |
| 6 | Furniture Manufacturer | 0-3 | Enhanced Inventory | IOC, SOC |
| 7 | Machine Shop | 0-3 | Enhanced Inventory | VOC |

| | | | | |
|----|-------------------------|------|--------------------|-------------------------|
| 8 | Transfer Station | 0-3 | Enhanced Inventory | IOC, VOC, SOC |
| | Big Wood River | 0-10 | Database Search | IOC, VOC, SOC, Microbes |
| | Highway 75 | 0-10 | Database Search | IOC, VOC, SOC, Microbes |
| 9 | LUST-complete | 3-6 | Database Search | VOC, SOC |
| 10 | LUST-complete | 3-6 | Database Search | VOC, SOC |
| 11 | NPDES | 3-6 | Database Search | IOC |
| 12 | Automotive-Repair | 3-6 | Enhanced Inventory | VOC, SOC |
| 13 | LUST-incomplete | 6-10 | Database Search | VOC, SOC |
| 14 | LUST-complete | 6-10 | Database Search | VOC, SOC |
| 15 | LUST-complete | 6-10 | Database Search | VOC, SOC |
| 16 | LUST-complete | 6-10 | Database Search | VOC, SOC |
| 17 | LUST-complete | 6-10 | Database Search | VOC, SOC |
| 18 | LUST-complete | 6-10 | Database Search | VOC, SOC |
| 19 | LUST-complete | 6-10 | Database Search | VOC, SOC |
| 20 | LUST-complete | 6-10 | Database Search | VOC, SOC |
| 21 | LUST-complete | 6-10 | Database Search | VOC, SOC |
| 22 | LUST-complete | 6-10 | Database Search | VOC, SOC |
| 23 | UST-closed | 6-10 | Database Search | VOC, SOC |
| 24 | UST-open | 6-10 | Database Search | VOC, SOC |
| 25 | UST-open | 6-10 | Database Search | VOC, SOC |
| 26 | UST-closed | 6-10 | Database Search | VOC, SOC |
| 27 | General Contractor | 6-10 | Database Search | VOC, SOC |
| 28 | General Contractor | 6-10 | Database Search | VOC, SOC |
| 29 | General Contractor | 6-10 | Database Search | VOC, SOC |
| 30 | Aircraft Charter | 6-10 | Database Search | VOC, SOC |
| 31 | Taxicabs | 6-10 | Database Search | VOC, SOC |
| 32 | Building Contractor | 6-10 | Database Search | VOC, SOC |
| 33 | Cleaner | 6-10 | Database Search | VOC |
| 34 | Motorcycle-Repair | 6-10 | Database Search | VOC, SOC |
| 35 | Commercial Photographer | 6-10 | Database Search | IOC, VOC |
| 36 | General Contractor | 6-10 | Database Search | VOC, SOC |
| 37 | Publisher | 6-10 | Database Search | IOC, VOC |
| 38 | General Contractor | 6-10 | Database Search | VOC, SOC |
| 39 | Commercial Photographer | 6-10 | Database Search | IOC, VOC |
| 40 | General Contractor | 6-10 | Database Search | VOC, SOC |
| 41 | Delivery Service | 6-10 | Database Search | VOC, SOC |
| 42 | Batteries-Wholesale | 6-10 | Database Search | IOC |
| 43 | Cleaners | 6-10 | Database Search | VOC |
| 44 | Home Manufacturing | 6-10 | Database Search | IOC, VOC, SOC |
| 45 | Outdoor Adventure | 6-10 | Database Search | VOC, SOC |
| 46 | Automotive-Supplies | 6-10 | Database Search | VOC, SOC |
| 47 | Photo Finishing | 6-10 | Database Search | IOC, VOC |
| 48 | Outdoor Adventure | 6-10 | Database Search | VOC, SOC |
| 49 | CERCLA | 6-10 | Database Search | IOC, VOC, SOC |
| 50 | SARA | 6-10 | Database Search | IOC, VOC |
| 51 | SARA | 6-10 | Database Search | VOC, SOC |
| 52 | SARA | 6-10 | Database Search | VOC, SOC |


IOC = inorganic chemical, VOC = volatile organic chemical, SOC = synthetic organic chemical

FIGURE 2 - COUNTRY CHALET M.H.P.: Delineation Map and Potential Contaminant Source Locations

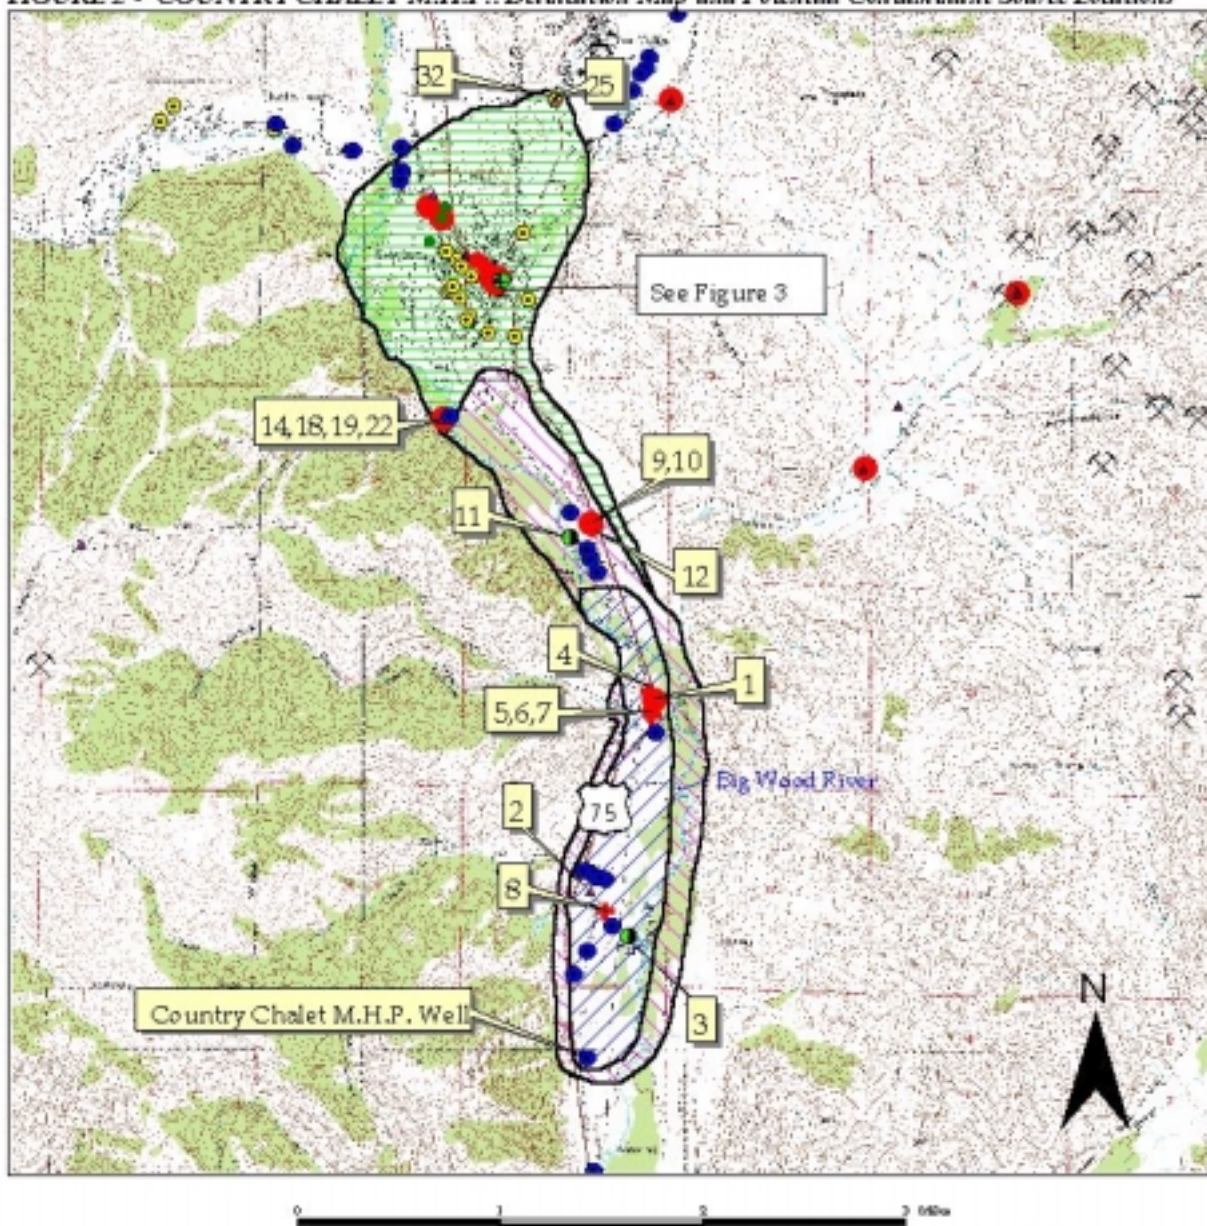

PWS 5070012
WELL #1

FIGURE 3 - COUNTRY CHALET M.H.P.: Delineation Map and Potential Contaminant Source Locations

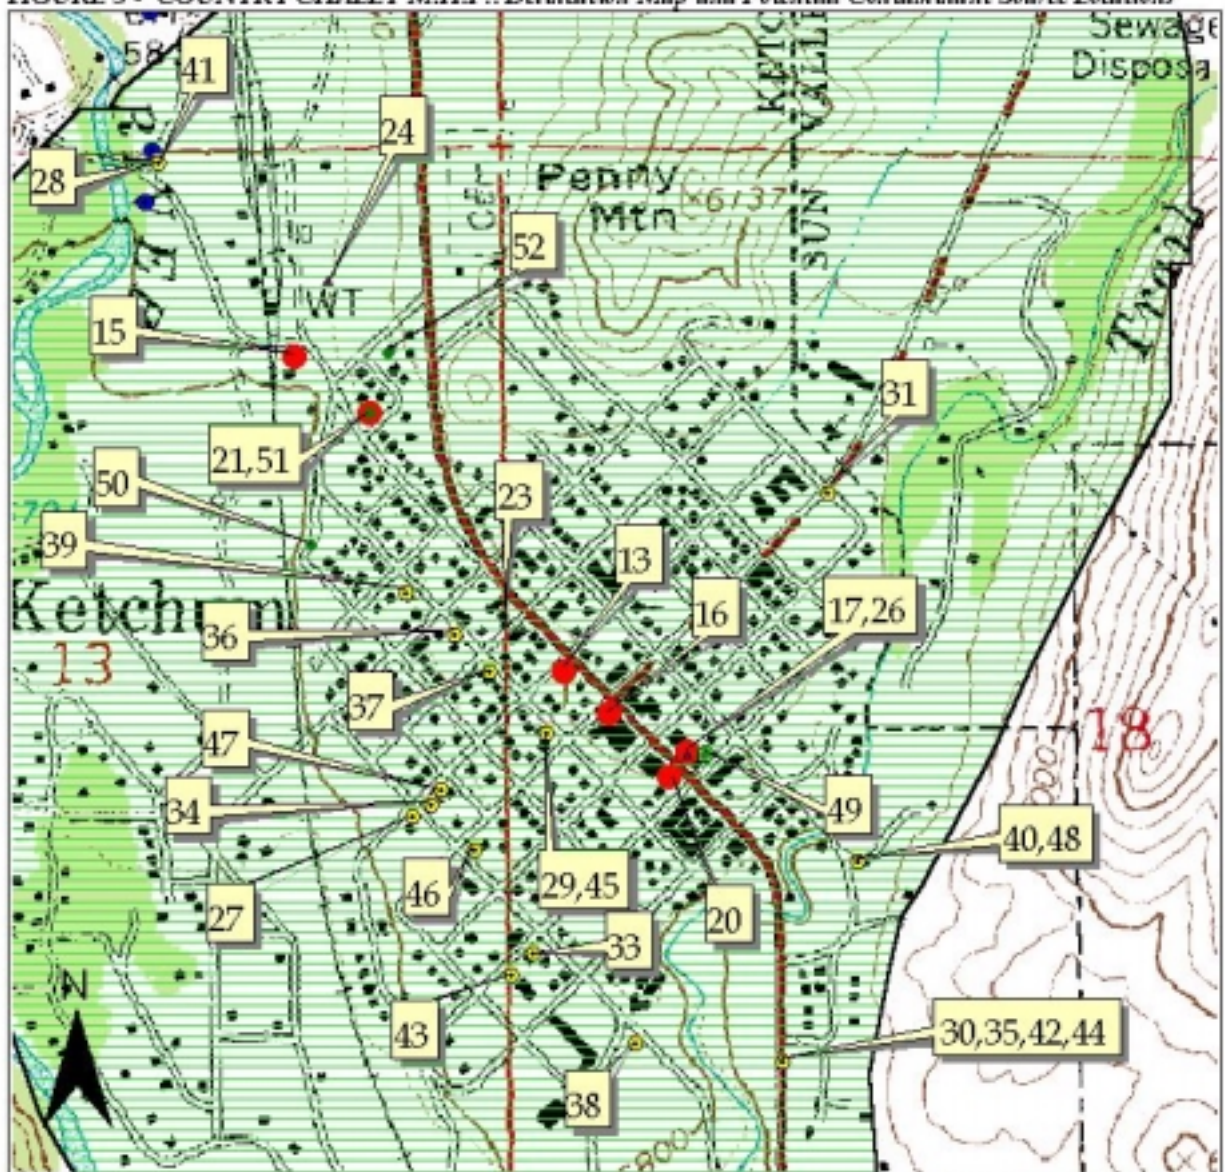

PWS 5070012
WELL #1

Section 3. Susceptibility Analyses

Significant potential sources of contamination were ranked as high, moderate, or low risk according to the following considerations: hydrologic characteristics, physical integrity of the well, land use characteristics, and potentially significant contaminant sources. The susceptibility rankings are specific to a particular potential contaminant or category of contaminants. Therefore, a high susceptibility rating relative to one potential contaminant does not mean that the water system is at the same risk for all other potential contaminants. The relative ranking that is derived for each well is a qualitative, screening-level step that, in many cases, uses generalized assumptions and best professional judgement. The following summaries describe the rationale for the susceptibility ranking.

Hydrologic Sensitivity

Hydrologic sensitivity was high for Country Chalet MHP drinking water system (see Table 2). Multiple factors increase the likelihood of movement of contaminants from the surface to the aquifer and lead to this high score. The soils within the delineation are classified as moderate to well drained. The lack of a well log prevents the determination of the depth to water, of existing low permeability units, and of the makeup of the vadose zone (zone from land surface to the water table) and whether these factors will reduce the downward movement of contaminants.

Well Construction

Well construction directly affects the ability of the wells to protect the aquifer from contaminants. The Country Chalet MHP drinking water system consists of one well that extracts groundwater for domestic uses. The system construction score was high (Table 2). A Drinking Water Supply Report completed in 1996 showed that the wellhead and sanitary seals were not in substantial compliance with regulations. The report also showed that the well was protected from surface flooding.

The Country Chalet MHP 1996 IDEQ Drinking Water Supply Report states that the pump is set at 105 feet below ground surface, but that the well depth is unknown. The well vent was not providing adequate protection from contamination. Though the well may have been in compliance with standards when it was drilled, current public water system (PWS) well construction standards are more stringent.

The IDWR Well Construction Standards Rules (1993) require all PWSs to follow IDEQ standards as well. IDAPA 58.01.08.550 requires that PWSs follow the Recommended Standards for Water Works (1997) when during construction. Table 1 of the Recommended Standards for Water Works (1997) states that 12-inch casing requires a thickness of 0.375 inches.

Based on nearby well logs and previous studies of the area (Castelin and Winner, 1975; Frenzel, 1989; Brockway and Kahlow, 1994), the Country Chalet MHP well is most likely completed in the fluvioglacial (river and glacier deposited) sediments comprises of fine to coarse-grained gravel that have considerable quantities of water available for use.

Potential Contaminant Source and Land Use

The well rated moderate for inorganic chemicals (IOCs) (i.e. nitrate), synthetic organic chemicals (SOCs) (i.e. pesticides), and volatile organic chemicals (VOCs) (i.e. petroleum products). The well rated low for microbial contaminants. There is the potential for VOCs, IOCs, and microbial contamination within 50 feet of the wellhouse. Commercial and industrial land uses in the delineated

source area contributed the largest numbers of IOC, VOC, and SOC points to the contaminant inventory rating. The Big Wood River and Highway 75 could potentially contribute IOC, VOC, SOC, and microbial contaminants to the well.

Final Susceptibility Ranking

Detections above drinking water standard Maximum Contaminant Levels (MCLs) or a detection of total coliform bacteria or fecal coliform bacteria will automatically give a high susceptibility rating to a well despite the land use of the area because a pathway for contamination already exists. Hydrologic sensitivity and system construction scores are heavily weighted in the final scores. Having multiple potential contaminant sources in the 0 to 3-year time of travel zone (Zone 1B) contribute greatly to the overall ranking. In this case, the well rates high for VOC and SOC contamination. The well rates moderate for IOC and microbial contaminants.

Table 2. Summary of Chalet MHP Susceptibility Evaluation

| Well | Susceptibility Scores | | | | | | | | | |
|---------|------------------------|-----------------------|-----|-----|------------|---------------------|------------------------------|-----|-----|------------|
| | Hydrologic Sensitivity | Contaminant Inventory | | | | System Construction | Final Susceptibility Ranking | | | |
| | | IOC | VOC | SOC | Microbials | | IOC | VOC | SOC | Microbials |
| Well #1 | H | M | M | M | L | H | H(*) | H | H | H(*) |

H = High Susceptibility, M = Moderate Susceptibility, Low Susceptibility

IOC = inorganic chemical, VOC = volatile organic chemical, SOC = synthetic organic chemical

H(*) - Indicates source scored high as well as automatically scoring high due to the possible presence of a VOC, IOC, and microbial source within 50 feet of the wellhead.

Susceptibility Summary

Water chemistry data show that no type of contamination currently threatens Country Chalet MHP drinking water system. However, the well shows a high susceptibility to IOC, VOC, SOC and microbial contamination from nearby potential contaminant sources (Table 1). Lowering the system construction score through compliance with the recommendations of the 1996 IDEQ Drinking Water Supply Report and removing hazardous substances and livestock from the well lot area will lower the overall susceptibility ratings to moderate for IOCs and microbial contamination.

The well in Country Chalet MHP system probably takes water from the alluvial (river deposited) aquifer that comprises the valley floor. The valley floor is ½ mile to 1-½ miles in width. The depth of the valley fill in the area of Country Chalet MHP is approximately 40 to 100 feet below land surface (Castelin and Winner, 1975). The groundwater and surface water systems are hydraulically connected and the hydraulic potential within the aquifer does not vary greatly. Recharge is primarily from precipitation, tributary valley underflow, and canal and stream seepage losses (Luttrell and Brockway, 1984). Water quality problems have been attributed to sewage treatment facilities, mining, construction, and agriculture (Castelin and Winner, 1975).

Section 4. Options for Source Water Protection

The susceptibility assessment should be used as a basis for determining appropriate new protection measures or re-evaluating existing protection efforts. No matter what the susceptibility ranking a source receives, protection is always important. Whether the source is currently located in a “pristine” area or an area with numerous industrial and/or agricultural land uses that require education and surveillance, the way to ensure good water quality in the future is to act now to protect valuable water supply resources.

An effective source water protection program is tailored to the particular local source water protection area. A community with a fully developed source water protection program will incorporate many strategies. For Country Chalet Mobile Home Park, source water protection activities should focus on sustaining and implementing practices aimed at wellhead protection. Issues raised in the recent 1996 Drinking Water Supply Report should be addressed. Bringing the wellhead and surface seal up to standards will reduce the susceptibility ratings to moderate for inorganic and microbial contamination. Other practices aimed at reducing the movement of contaminants within the designated source water areas should be investigated. Disinfection practices could be implemented if microbial contamination ever became a concern. With the direct connection between the surface water and groundwater systems, any surface water discharges to the Big Wood River should be adequately monitored. Though agricultural activities are currently not a major land use, the highly permeable nature of the soils and the movement rates of the water through the aquifer could make agricultural chemical leaching a concern. Most of the delineated areas are outside the direct jurisdiction of Country Chalet MHP. Partnerships with state and local agricultural agencies, county elected officials, and industry groups should be established and are critical to success. Due to the time involved with the movement of groundwater, wellhead protection activities should be aimed at long-term management strategies even though these strategies may not yield results in the near term.

Assistance

Public water supplies and others may call the following IDEQ offices with questions about this assessment and to request assistance with developing and implementing a local protection plan. In addition, draft protection plans may be submitted to the IDEQ office for preliminary review and comments.

Twin Falls Regional IDEQ Office (208) 736-2190

State IDEQ Office (208) 373-0502

Website: <http://www2.state.id.us/deq>

Water suppliers serving fewer than 10,000 persons may contact John Bokor, Idaho Rural Water Association, at (208) 743-6142 for assistance with wellhead protection strategies.

POTENTIAL CONTAMINANT INVENTORY

LIST OF ACRONYMS AND DEFINITIONS

AST (Aboveground Storage Tanks) – Sites with aboveground storage tanks.

Business Mailing List – This list contains potential contaminant sites identified through a yellow pages database search of standard industry codes (SIC).

CERCLIS – This includes sites considered for listing under the **Comprehensive Environmental Response Compensation and Liability Act (CERCLA)**. CERCLA, more commonly known as Superfund is designed to clean up hazardous waste sites that are on the national priority list (NPL).

Cyanide Site – DEQ permitted and known historical sites/facilities using cyanide.

Dairy – Sites included in the primary contaminant source inventory represent those facilities regulated by Idaho State Department of Agriculture (ISDA) and may range from a few head to several thousand head of milking cows.

Deep Injection Well – Injection wells regulated under the Idaho Department of Water Resources generally for the disposal of stormwater runoff or agricultural field drainage.

Enhanced Inventory – Enhanced inventory locations are potential contaminant source sites added by the water system. These can include new sites not captured during the primary contaminant inventory, or corrected locations for sites not properly located during the primary contaminant inventory. Enhanced inventory sites can also include miscellaneous sites added by the Idaho Department of Environmental Quality (IDEQ) during the primary contaminant inventory.

Floodplain – This is a coverage of the 100-year floodplains.

Group 1 Sites – These are sites that show elevated levels of contaminants and are not within the priority one areas.

Inorganic Priority Area – Priority one areas where greater than 25% of the wells/springs show constituents higher than primary standards or other health standards.

Landfill – Areas of open and closed municipal and non-municipal landfills.

LUST (Leaking Underground Storage Tank) – Potential contaminant source sites associated with leaking underground storage tanks as regulated under RCRA.

Mines and Quarries – Mines and quarries permitted through the Idaho Department of Lands.)

Nitrate Priority Area – Area where greater than 25% of wells/springs show nitrate values above 5mg/l.

NPDES (National Pollutant Discharge Elimination System) – Sites with NPDES permits. The Clean Water Act requires that any discharge of a pollutant to waters of the United States from a point source must be authorized by an NPDES permit.

Organic Priority Areas – These are any areas where greater than 25 % of wells/springs show levels greater than 1% of the primary standard or other health standards.

Recharge Point – This includes active, proposed, and possible recharge sites on the Snake River Plain.

RICRIS – Site regulated under **Resource Conservation Recovery Act (RCRA)**. RCRA is commonly associated with the cradle to grave management approach for generation, storage, and disposal of hazardous wastes.

SARA Tier II (Superfund Amendments and Reauthorization Act Tier II Facilities) – These sites store certain types and amounts of hazardous materials and must be identified under the Community Right to Know Act.

Toxic Release Inventory (TRI) – The toxic release inventory list was developed as part of the Emergency Planning and Community Right to Know (Community Right to Know) Act passed in 1986. The Community Right to Know Act requires the reporting of any release of a chemical found on the TRI list.

UST (Underground Storage Tank) – Potential contaminant source sites associated with underground storage tanks regulated as regulated under RCRA.

Wastewater Land Applications Sites – These are areas where the land application of municipal or industrial wastewater is permitted by IDEQ.

Wellheads – These are drinking water well locations regulated under the Safe Drinking Water Act. They are not treated as potential contaminant sources.

NOTE: Many of the potential contaminant sources were located using a geocoding program where mailing addresses are used to locate a facility. Field verification of potential contaminant sources is an important element of an enhanced inventory.

Where possible, a list of potential contaminant sites unable to be located with geocoding will be provided to water systems to determine if the potential contaminant sources are located within the source water assessment area.

References Cited

- Anderson, J.E. and K. Bideganeta. 1985. "A Preliminary Geologic Reconnaissance of the Geothermal Occurrences of the Wood River Drainage Area." Water Information Bulletin No. 30. Idaho Department of Water Resources. 49 pages.
- Brockway, C.E. and M.A. Kahlow. 1994. "Hydrologic Evaluation of the Big Wood River – Silver Creek Watersheds." Idaho Water Resources Research Institute. 77 pages.
- Castelin, P.M. and J.E. Winner. 1975. "Effects of Urbanization on the Water Resources of the Sun Valley-Ketchum Area, Blaine County, Idaho." Water Information Bulletin No. 40. Idaho Department of Water Resources. 86 pages.
- Frenzel, S.A. 1989. "Water Resources of the Upper Big Wood River Basin, Idaho." U.S. Geological Survey. Water-Resources Investigations Report 89-4018. 47 pages.
- Great Lakes-Upper Mississippi River Board of State and Provincial Public Health and Environmental Managers, 1997. "Recommended Standards for Water Works."
- Idaho Department of Environmental Quality. 1997. Design Standards for Public Drinking Water Systems. IDAPA 58.01.08.550.01.
- Idaho Department of Water Resources, 1993. Administrative Rules of the Idaho Water Resource Board: Well Construction Standards Rules. IDAPA 37.03.09.
- Luttrell, S.P. and C.E. Brockway. 1982. "Impacts of Individual On-Site Sewage Disposal Facilities on Mountain Valleys – Phase I. Research Technical Completion Report A-084-IDA. Idaho Water and Energy Resources Research Institute. University of Idaho. 52 pages.
- Luttrell, S.P. and C.E. Brockway. 1984. "Impacts of Individual On-Site Sewage Disposal Facilities on Mountain Valleys – Phase II – Water-Quality Considerations. Research Technical Completion Report WRIP/371403. Idaho Water and Energy Resources Research Institute. University of Idaho. 74 pages.

Attachment A

Country Chalet MHP Susceptibility Analysis Worksheet

The final scores for the susceptibility analysis were determined using the following formulas:

- 1) VOC/SOC/IOC Final Score = Hydrologic Sensitivity + System Construction + (Potential Contaminant/Land Use x 0.2)
- 2) 2) Microbial Final Score = Hydrologic Sensitivity + System Construction + (Potential Contaminant/Land Use x 0.35)

Final Susceptibility Scoring:

0 - 5 Low Susceptibility

6 - 12 Moderate Susceptibility

≥ 13 High Susceptibility

| | | | | | |
|--|---------------------------------|-----------|-----------|-----------|-----------------|
| 1. System Construction | | SCORE | | | |
| Drill Date | 01/01/1960 | | | | |
| Driller Log Available | NO | | | | |
| Sanitary Survey (if yes, indicate date of last survey) | YES | 1996 | | | |
| Well meets IDWR construction standards | NO | 1 | | | |
| Wellhead and surface seal maintained | NO | 1 | | | |
| Casing and annular seal extend to low permeability unit | NO | 2 | | | |
| Highest production 100 feet below static water level | NO | 1 | | | |
| Well located outside the 100 year flood plain | YES | 0 | | | |
| Total System Construction Score | | 5 | | | |
| 2. Hydrologic Sensitivity | | | | | |
| Soils are poorly to moderately drained | NO | 2 | | | |
| Vadose zone composed of gravel, fractured rock or unknown | YES | 1 | | | |
| Depth to first water > 300 feet | NO | 1 | | | |
| Aquitard present with > 50 feet cumulative thickness | NO | 2 | | | |
| Total Hydrologic Score | | 6 | | | |
| 3. Potential Contaminant / Land Use - ZONE 1A | | IOC Score | VOC Score | SOC Score | Microbial Score |
| Land Use Zone 1A | RANGELAND, WOODLAND, BASALT | 0 | 0 | 0 | 0 |
| Farm chemical use high | NO | 0 | 0 | 0 | |
| IOC, VOC, SOC, or Microbial sources in Zone 1A | YES | YES | YES | NO | YES |
| Total Potential Contaminant Source/Land Use Score - Zone 1A | | 0 | 0 | 0 | 0 |
| Potential Contaminant / Land Use - ZONE 1B | | | | | |
| Contaminant sources present (Number of Sources) | YES | 6 | 7 | 8 | 2 |
| (Score = # Sources X 2) 8 Points Maximum | | 8 | 8 | 8 | 4 |
| Sources of Class II or III leacheable contaminants or | YES | 0 | 2 | 2 | |
| 4 Points Maximum | | 0 | 2 | 2 | |
| Zone 1B contains or intercepts a Group 1 Area | NO | 0 | 0 | 0 | 0 |
| Land use Zone 1B | Less Than 25% Agricultural Land | 0 | 0 | 0 | 0 |
| Total Potential Contaminant Source / Land Use Score - Zone 1B | | 8 | 10 | 10 | 4 |
| Potential Contaminant / Land Use - ZONE II | | | | | |
| Contaminant Sources Present | YES | 2 | 2 | 2 | |
| Sources of Class II or III leacheable contaminants or | YES | 0 | 1 | 0 | |
| Land Use Zone II | Less than 25% Agricultural Land | 0 | 0 | 0 | |
| Potential Contaminant Source / Land Use Score - Zone II | | 2 | 3 | 2 | 0 |
| Potential Contaminant / Land Use - ZONE III | | | | | |
| Contaminant Source Present | YES | 1 | 1 | 1 | |
| Sources of Class II or III leacheable contaminants or | YES | 1 | 1 | 0 | |
| Is there irrigated agricultural lands that occupy > 50% of | NO | 0 | 0 | 0 | |
| Total Potential Contaminant Source / Land Use Score - Zone III | | 2 | 2 | 1 | 0 |
| Cumulative Potential Contaminant / Land Use Score | | 12 | 15 | 13 | 4 |
| 4. Final Susceptibility Source Score | | 13 | 14 | 14 | 13 |
| 5. Final Well Ranking | | High | High | High | High |